


CONSTRUCTION CONTROL JOINT DETAIL

NOT TO SCALE

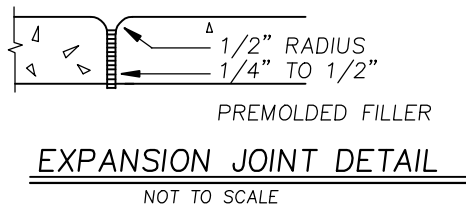

NOTES:

1. EXPANSION JOINT NEEDED EVERY 50'. TROWELLED CONTROL JOINT NEEDED EVERY 5'.
2. IN LIEU OF WIRE WOVEN FABRIC CONTRACTOR MAY USE CONCRETE REINFORCED WITH FIBERMESH AS AN ACCEPTABLE ALTERNATE.
3. SPECIAL ATTENTION SHALL BE GIVEN TO THE GRADED SOD PLACEMENT TRENCH. THE GRADING BY THE CONTRACTOR SHALL PROVIDE A 1/2" DROP FROM THE SIDEWALK TO THE TOP OF THE SOD.
4. SIDEWALKS ABUTTING DRAINAGE STRUCTURES SHALL BE LEVEL WITH THE TOP OF THE STRUCTURE.

TITLE: ROADWAY STANDARD
SIDEWALK

APPROVED BY: C. G. MIXSON, P. E.
DATE: 10-01-08
NO.: IV-30

HERNANDO COUNTY
DEPARTMENT OF PUBLIC WORKS
ENGINEERING DIVISION
1625 E. JEFFERSON ST.
BROOKSVILLE, FLORIDA 34601
PH. (352)764-4062 FAX. (352)764-4423